

小会議室 (吹出口)	OA: 300 m ³ /h	2
VHS: 250 x 200		
小会議室 (吸入口)	EA: 300 m ³ /h	2
HS: 250 x 200		

小会議室 (FCU接続)	OA: 600 m ³ /h	2
VHS: 1400 x 150		

大会議室 (FCU接続)	OA: 267 m ³ /h	6
VHS: 1000 x 150		

宴会場 (FCU接続)	OA: 900 m ³ /h	4
VHS: 1200 x 200		

フロント (吹出口)	OA: 250 m ³ /h	1
VHS: 200 x 200		
フロント (吸入口)	EA: 250 m ³ /h	1
HS: 200 x 200		

W C (吹出口)	EA: 135 m ³ /h	6
HS: 150 x 150		

無沸室 (吹出口)	EA: 100 m ³ /h	1
HS: 150 x 100		


大会議室 (吹出口)	EA: 135 m ³ /h	6
BL-(S): 1000 L		

宴会場 (吹出口)	EA: 463 m ³ /h	4
CL-2: 1500 L		


宴会場・新室・廊下 (吹出口)	EA: 1550 m ³ /h	4
CL-6: 1500 L		

前室 (吹出口)	EA: 400 m ³ /h	1
HS: 250 x 250		

2階平面図 S=1:100

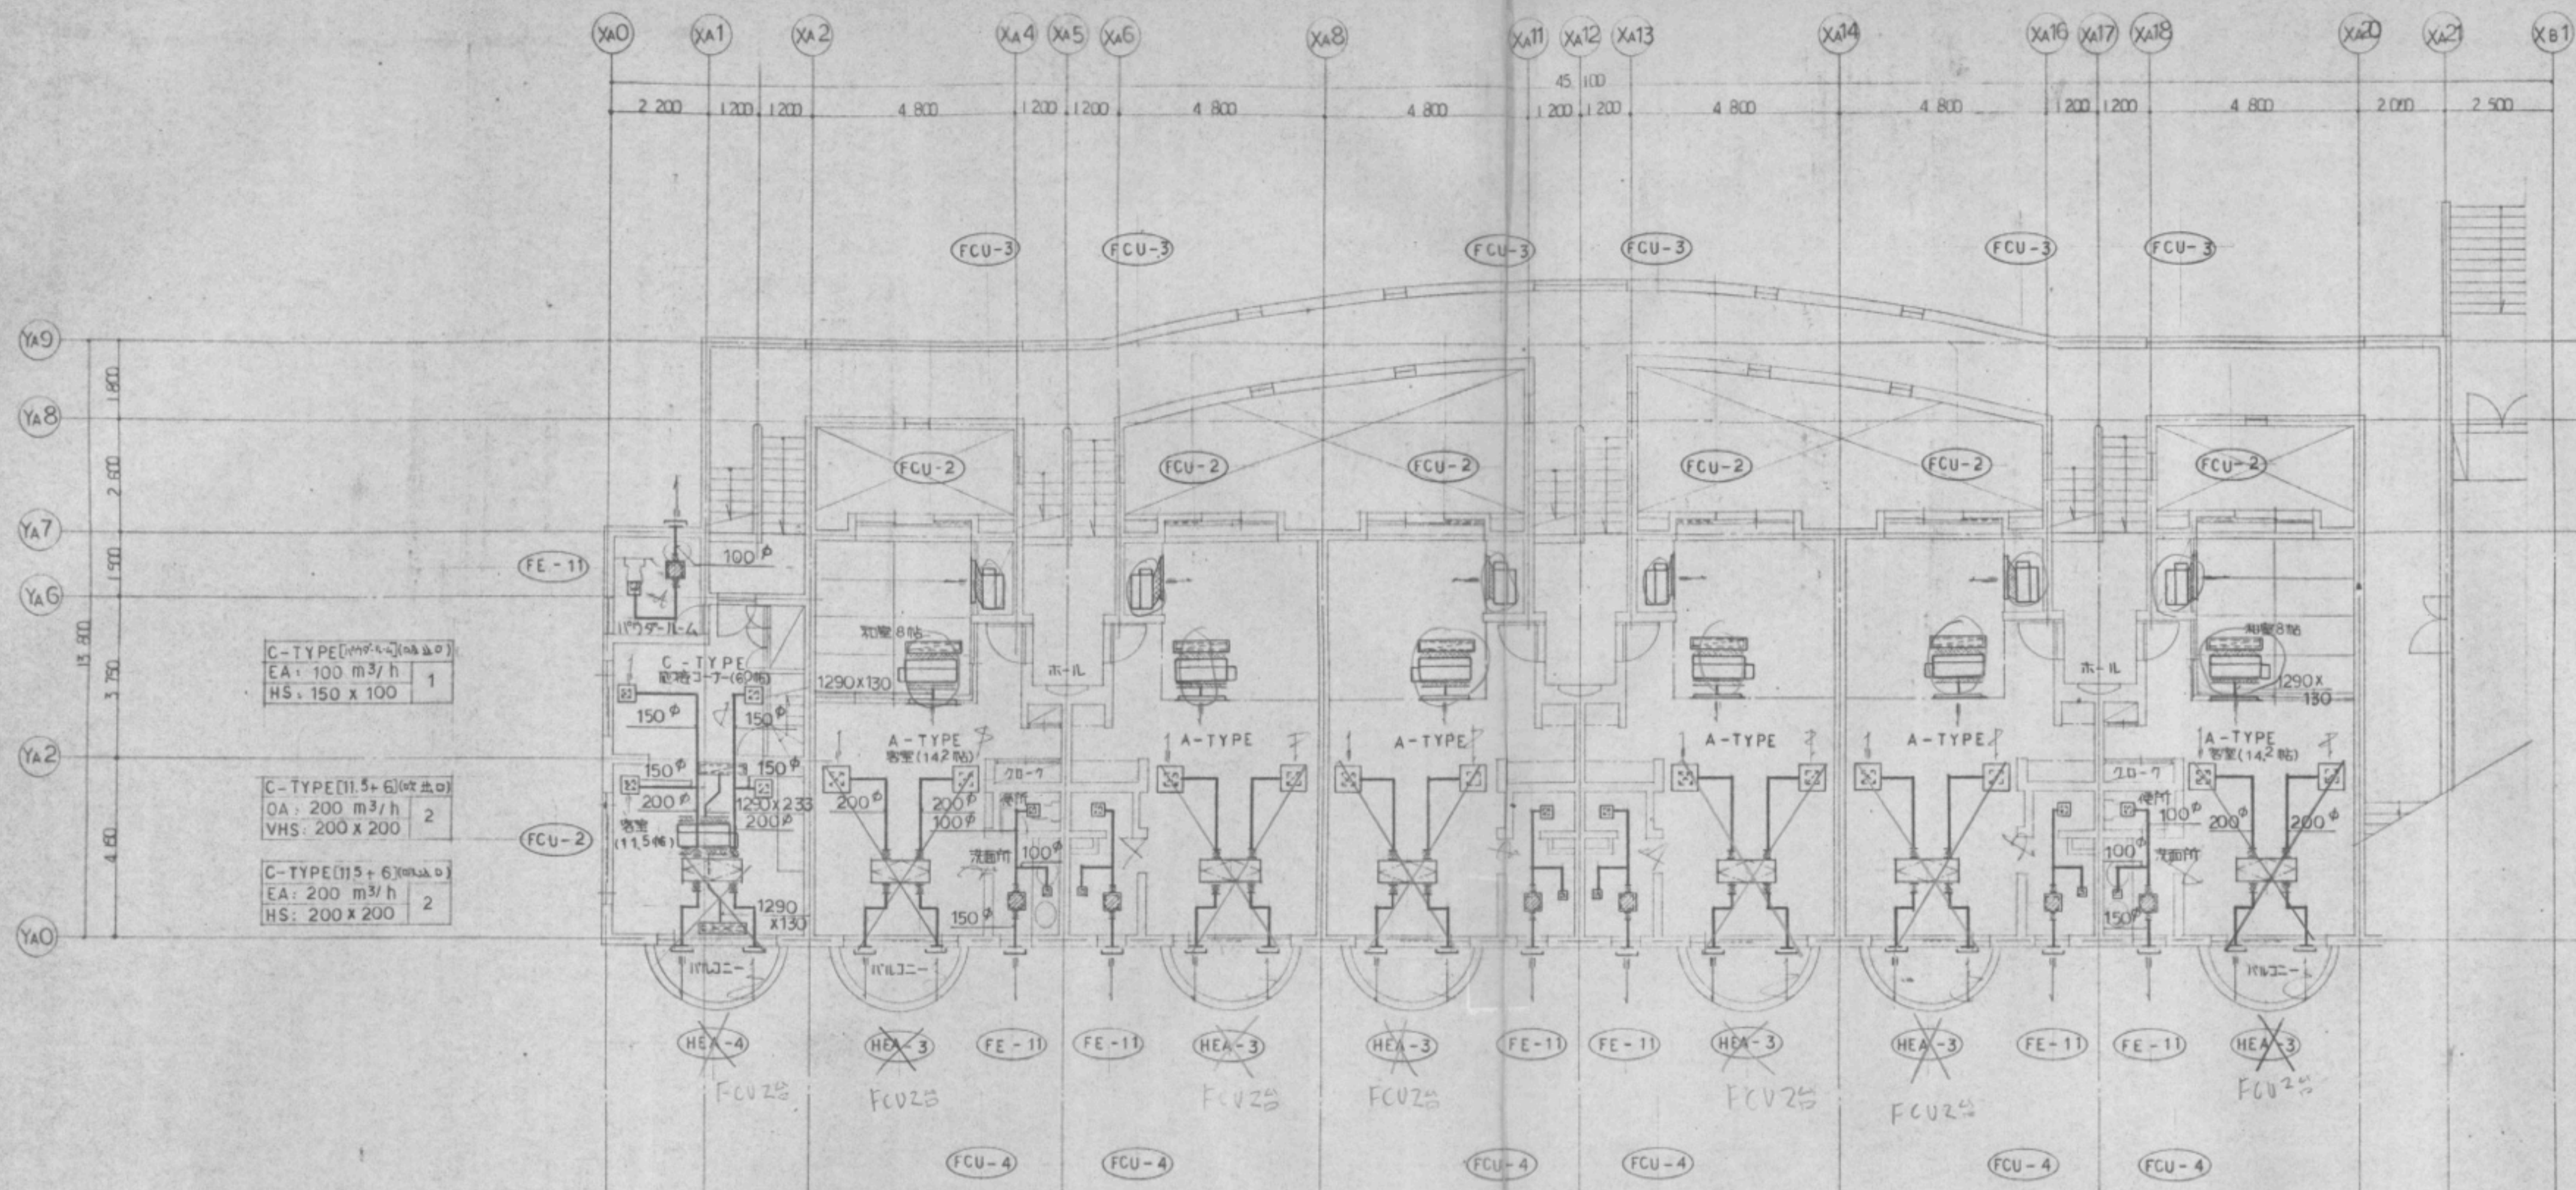

2階平面図 S=1:100

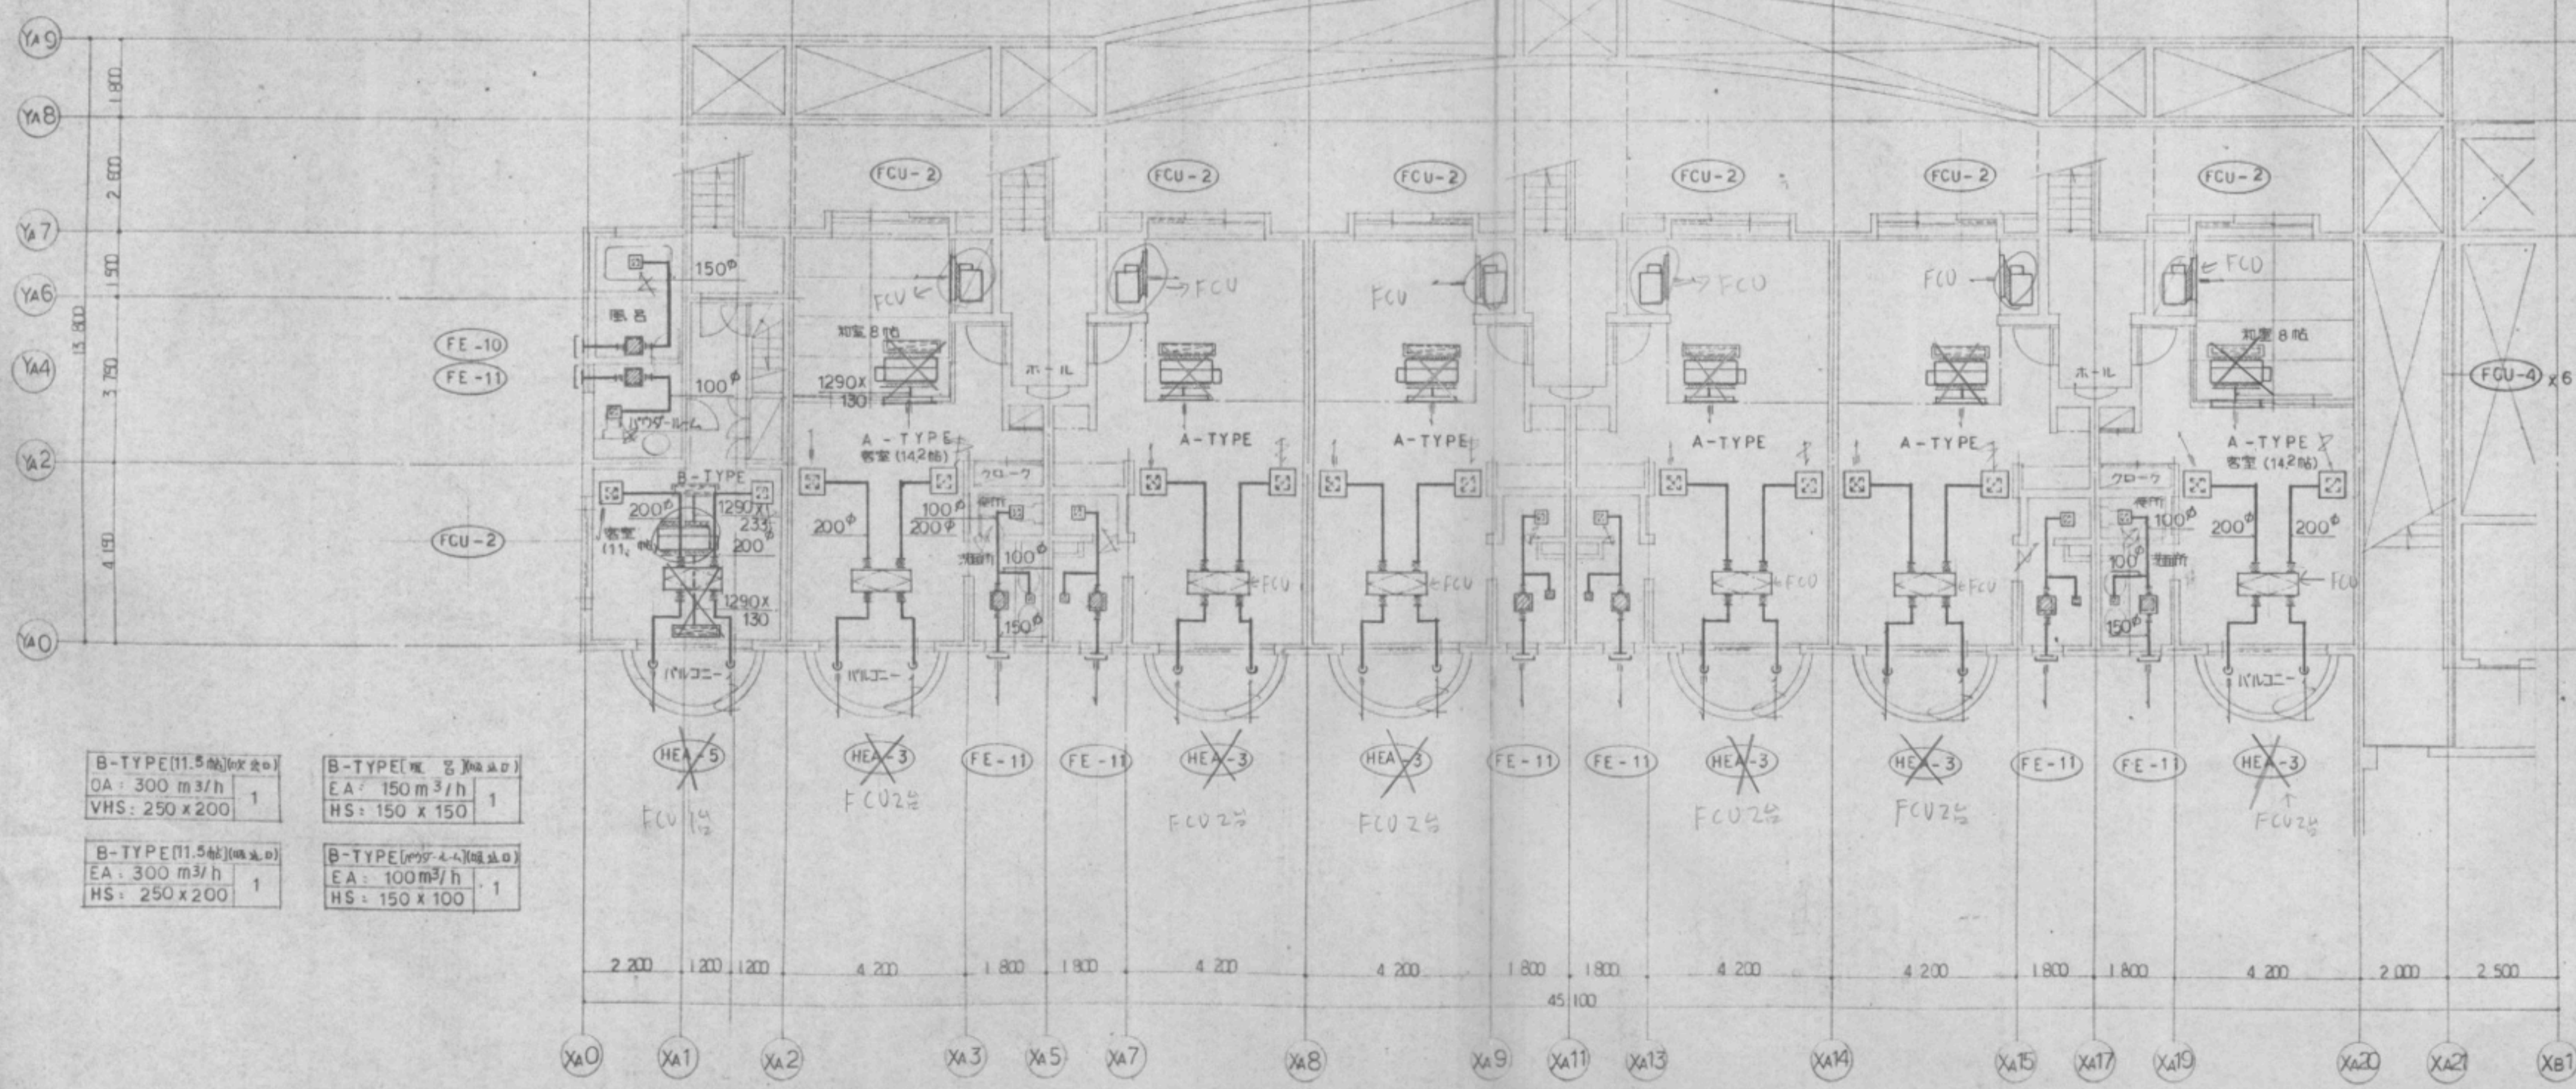

1階平面図 S=1:100